

# Bay Area WTP


## Monthly Operations Report



November, 2021

Water Systems Serial Number:

0465

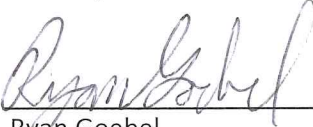


Ryan Goebel

Water Plant Superintendent

Title

F-1

Classification

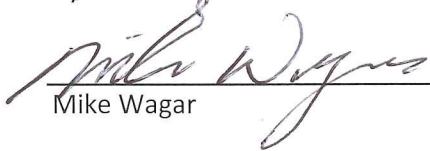

Mike Wagar

Operations Supervisor

Title

F-2

Classification

# Bay Area Water Treatment Plant

## Monthly Operations Report

Supply Name: Bay Area Water System  
 WSSN: 0465

November, 2021  
 Month, Year

F-1  
 Water Plant Classification

Bay  
 County

Ryan Goebel  
 Operator-in-charge

F-1  
 Certification of Operator-in-charge

### Treatment Rate and Membrane Data

Treatment Rate, Approved Rated Plant Capacity	<u>17.4</u>	Millions of Gallons per Day
Treatment Rate, Maximum	<u>7.7</u>	Millions of Gallons per Day
Maximum Approved Transmembrane Pressure	<u>22</u>	PSI
Maximum Operating Transmembrane Pressure	<u>16.50</u>	PSI
Maximum Approved Flux Rate	<u>36.25</u>	gpd/sq.ft.
Maximum Operating Flux Rate	<u>29.74</u>	gpd/sq.ft.

### Chemical Data

Sodium Hypochlorite on hand:	<u>7,845</u>	Gallons	Estimated Supply:	<u>123.7</u>	days
Caustic Soda on hand:	<u>3,239</u>	Gallons	Estimated Supply:	<u>199.4</u>	days
Corrosion Inhibitor on hand:	<u>1,212</u>	Gallons	Estimated Supply:	<u>56.4</u>	days
Hydrofluosilicic Acid on hand:	<u>810</u>	Gallons	Estimated Supply:	<u>42.7</u>	days
Aluminum Chlorohydrate on hand:	<u>706</u>	Gallons	Estimated Supply:	<u>73.3</u>	days
Sulfuric Acid on hand:	<u>734</u>	Gallons	Estimated Supply:	<u>282.6</u>	days
Sodium Bisulfite on hand:	<u>871</u>	Gallons	Estimated Supply:	<u>152.4</u>	days
Citric Acid on hand:	<u>3,076</u>	Gallons	Estimated Supply:	<u>200.8</u>	days
Cost of All Chemicals per Million Gallons:	<u>72.71</u>	Dollars			
Estimated Electrical Cost per Million Gallons:	<u>89.12</u>	Dollars			
Estimated Natural Gas Cost per Million Gallons:	<u>6.61</u>	Dollars			

### Remarks

Number of periods of filter confluence turbidity samples > 0.3 NTU	<u>0</u>
Percent of membrane period confluence samples > 0.3 NTU:	<u>0.00%</u>
Was continuous (every 15 minutes) filter monitoring equipment off-line during the month? If yes, indicate date(s), duration, and individual filter grab sampling frequency on a separate sheet.	<u>No</u>
Did POE disinfectant residual fall below 0.2 ppm during the month? If yes, indicate date(s) and duration on a separate sheet.	<u>No</u>
Was minimum C*T credit achieved for the entire month? If no, indicate on a separate sheet the date(s) not achieved.	<u>Yes</u>
Was continuous POE chlorine residual monitoring equipment off-line during the month? If yes, date(s) and duration will be indicated on the rule page.	<u>No</u>



### Notes

# Bay Area WTP Monthly Operating Report

Flows									
Date	Raw Water (MG)			Clarified (MG)	Sludge (MG)	Treated (MG)	Finished Water Pumped (MG)		
	North	South	Total	Total	Total	Total	N. Euclid	Lauria Road	Total
	FIT-1000-1	FIT-1000-2	Calculated	FIT-5520-1	FIT-5180	FIT-4000-1	FIT-4040-1	FIT-4040-2	Calculated
11/1/2021	0.00	6.77	6.77	0.24	0.08	7.18	3.49	3.18	6.67
11/2/2021	0.00	6.79	6.79	0.25	0.08	6.83	3.50	3.23	6.74
11/3/2021	0.00	7.34	7.34	0.23	0.09	7.31	3.65	3.36	7.01
11/4/2021	0.00	7.65	7.65	0.22	0.08	7.24	3.60	3.36	6.96
11/5/2021	0.00	6.46	6.46	0.23	0.08	6.95	3.43	3.21	6.64
11/6/2021	0.00	6.66	6.66	0.24	0.08	7.15	3.49	3.30	6.78
11/7/2021	0.00	6.20	6.20	0.28	0.09	7.73	3.82	3.52	7.34
11/8/2021	0.00	6.04	6.04	0.21	0.08	6.43	3.28	3.05	6.33
11/9/2021	0.00	9.50	9.50	0.25	0.08	6.87	3.30	3.27	6.57
11/10/2021	0.00	8.01	8.01	0.23	0.09	7.32	3.55	3.34	6.89
11/11/2021	0.00	6.69	6.69	0.24	0.08	7.04	3.49	3.29	6.78
11/12/2021	0.00	6.71	6.71	0.24	0.07	6.98	3.43	3.24	6.67
11/13/2021	0.00	6.85	6.85	0.22	0.10	6.77	3.27	3.17	6.45
11/14/2021	0.00	6.79	6.79	0.22	0.08	6.72	3.30	3.16	6.46
11/15/2021	0.00	7.11	7.11	0.22	0.08	6.76	3.25	3.13	6.37
11/16/2021	0.00	6.15	6.15	0.21	0.08	6.53	3.17	3.03	6.20
11/17/2021	0.00	7.39	7.39	0.24	0.08	6.85	3.34	3.16	6.50
11/18/2021	0.00	6.19	6.19	0.23	0.08	6.44	3.16	3.01	6.17
11/19/2021	0.00	6.03	6.03	0.22	0.08	6.74	3.28	3.14	6.42
11/20/2021	0.00	7.02	7.02	0.23	0.08	6.85	3.35	3.17	6.52
11/21/2021	0.00	7.23	7.23	0.23	0.08	7.13	3.47	3.32	6.80
11/22/2021	0.00	7.56	7.56	0.23	0.08	6.87	3.39	3.23	6.63
11/23/2021	0.00	6.69	6.69	0.23	0.08	6.83	3.28	3.12	6.41
11/24/2021	0.00	6.86	6.86	0.24	0.08	7.05	3.53	3.29	6.82
11/25/2021	0.00	7.15	7.15	0.24	0.08	6.88	3.43	3.12	6.55
11/26/2021	0.00	7.34	7.34	0.23	0.09	6.66	3.32	3.10	6.42
11/27/2021	0.00	5.83	5.83	0.23	0.08	6.89	3.40	3.14	6.54
11/28/2021	0.00	6.72	6.72	0.23	0.08	6.59	3.28	3.03	6.31
11/29/2021	0.00	6.71	6.71	0.22	0.08	6.83	3.42	3.14	6.56
11/30/2021	0.00	7.32	7.32	0.23	0.08	6.89	3.38	3.22	6.60
Total	0.00	207.77	207.77	6.97	2.42	207.30	102.05	96.06	198.11
Avg	0.00	6.93	6.93	0.23	0.08	6.91	3.40	3.20	6.60
Min	0.00	5.83	5.83	0.21	0.07	6.43	3.16	3.01	6.17
Max	0.00	9.50	9.50	0.28	0.10	7.73	3.82	3.52	7.34



Raw Water Analysis								
Date	Temp	pH	Turbidity		F	Free Cl	Bacti	
	Average	Average	Average	Maximum	Grab	Average	Positive/Negative	
	°C		NTU		mg/L	mg/L	Total Coliform	E. coli
	TIT-1000	AIT-1000-2	AIT-1000-1		Lab	AIT-1035-2	Lab	
11/1/2021	14.5	7.69	5.22	11.90	0.09	0.54	Negative	Negative
11/2/2021	14.2	7.69	2.58	15.22	0.09	0.71	Negative	Negative
11/3/2021	14.3	7.69	1.37	1.66	0.09	0.66	Negative	Negative
11/4/2021	14.2	7.70	1.13	1.87	0.08	0.66	Negative	Negative
11/5/2021	14.1	7.70	1.01	4.69	0.08	0.67	Negative	Negative
11/6/2021	13.9	7.70	1.09	1.44	0.08	0.69	Negative	Negative
11/7/2021	13.6	7.71	1.16	1.68	0.08	0.71	Negative	Negative
11/8/2021	13.5	7.72	0.98	1.51	0.08	0.66	Negative	Negative
11/9/2021	13.1	7.74	0.88	1.27	0.08	0.61	Negative	Negative
11/10/2021	13.1	7.76	0.76	1.68	0.09	0.56	Negative	Negative
11/11/2021	12.9	7.77	0.76	1.57	0.08	0.54	Negative	Negative
11/12/2021	12.6	7.78	0.80	1.30	0.08	0.51	Negative	Negative
11/13/2021	12.3	7.78	1.58	2.83	0.08	0.46	Negative	Negative
11/14/2021	12.2	7.77	1.67	6.43	0.09	0.54	Negative	Negative
11/15/2021	11.9	7.77	1.08	4.64	0.10	0.57	Negative	Negative
11/16/2021	11.7	7.74	0.95	1.35	0.08	0.63	Negative	Negative
11/17/2021	11.6	7.74	0.80	1.23	0.08	0.63	Negative	Negative
11/18/2021	11.5	7.70	0.55	0.69	0.08	0.71	Negative	Negative
11/19/2021	11.5	7.70	0.51	0.71	0.08	0.66	Negative	Negative
11/20/2021	11.3	7.72	0.75	1.24	0.08	0.53	Negative	Negative
11/21/2021	11.2	7.74	0.83	1.36	0.08	0.49	Negative	Negative
11/22/2021	11.1	7.75	0.61	3.85	0.08	0.51	Negative	Negative
11/23/2021	11.0	7.75	0.56	1.02	0.08	0.49	Negative	Negative
11/24/2021	10.9	7.75	0.48	1.27	0.09	0.52	Negative	Negative
11/25/2021	10.8	7.77	0.49	1.09	0.09	0.51	Negative	Negative
11/26/2021	10.8	7.77	0.51	0.77	0.08	0.51	Negative	Negative
11/27/2021	10.6	7.76	0.55	0.71	0.09	0.52	Negative	Negative
11/28/2021	10.5	7.74	0.65	2.39	0.09	0.63	Negative	Negative
11/29/2021	9.4	7.76	0.62	1.76	0.08	0.58	Negative	Negative
11/30/2021	8.7	7.80	1.04	8.62	0.07	0.51	Negative	Negative
Avg	12.1	7.74	1.07	2.93	0.08	0.58	NA	NA
Min	8.7	7.69	0.48	0.69	0.07	0.46	NA	NA
Max	14.5	7.80	5.22	15.22	0.10	0.71	NA	NA



Finished Water Analysis																		
Date	Temp	pH	Phosphate	Fluoride		Free Cl <sub>2</sub>	Alkalinity (as CaCO <sub>3</sub> )		Chloride	Sulfate	Calcium (as CaCO <sub>3</sub> )	Dissolved Oxygen	Conductivity	Langelier Saturation Index	Chloride:Sulfate Mass Ratio	Larson-Skold Index	Bacti	
	Average	Average	Average	Tap	Dist	Average	Carbonate	Bicarbonate	Grab	Grab	Grab	Grab	Grab	Index	Ratio	Index	Positive/Negative	
	°C		mg/L	mg/L		mg/L	mg/L		mg/L	mg/L	mg/L	mg/L	uS/cm				Calculated	Lab
	AIT-4040-1	AIT-4050-2	AIT-4040-5	Lab		AIT-4050-1	Lab		Lab	Lab	Lab	Lab	Lab					
11/1/2021	13.4	7.64	3.47	0.77	0.76	1.22	0	84	11	11	78	9.4	239	-0.66	1.00	0.39	Negative	Negative
11/2/2021	13.1	7.63	3.50	0.76		1.23	0	88	11	10	78	9.4	239	-0.66	1.10	0.36	Negative	Negative
11/3/2021	13.0	7.63	3.36	0.77		1.23	0	81	11	10	80	9.5	222	-0.68	1.10	0.39	Negative	Negative
11/4/2021	13.1	7.62	3.38	0.75		1.20	0	77	10	8	70	9.8	223	-0.77	1.25	0.36	Negative	Negative
11/5/2021	13.1	7.62	3.38	0.78		1.20	0	77	10	9	70	9.7	223	-0.77	1.11	0.37	Negative	Negative
11/6/2021	13.0	7.63	3.37	0.75		1.21	0	77	10	9	68	9.8	224	-0.78	1.11	0.37	Negative	Negative
11/7/2021	12.7	7.63	3.38	0.76		1.22	0	78	10	9	70	9.8	225	-0.76	1.11	0.37	Negative	Negative
11/8/2021	12.6	7.64	3.35	0.75	0.74	1.19	0	78	10	8	70	9.8	225	-0.76	1.25	0.35	Negative	Negative
11/9/2021	12.2	7.64	3.39	0.77		1.20	0	78	10	9	72	9.7	226	-0.75	1.11	0.37	Negative	Negative
11/10/2021	12.0	7.64	3.40	0.76		1.20	0	84	11	11	72	10.4	228	-0.73	1.00	0.39	Negative	Negative
11/11/2021	11.8	7.66	3.41	0.79		1.16	0	80	10	10	72	10.3	228	-0.73	1.00	0.38	Negative	Negative
11/12/2021	11.6	7.67	3.40	0.76		1.20	0	82	10	11	78	9.9	230	-0.68	0.91	0.38	Negative	Negative
11/13/2021	11.3	7.69	3.39	0.76		1.19	0	80	11	12	76	10.3	229	-0.69	0.92	0.43	Negative	Negative
11/14/2021	11.2	7.69	3.39	0.75		1.19	0	82	10	12	72	10.2	233	-0.71	0.83	0.40	Negative	Negative
11/15/2021	10.9	7.69	3.38	0.77	0.76	1.21	0	80	10	11	79	10.1	231	-0.68	0.91	0.39	Negative	Negative
11/16/2021	10.7	7.68	3.38	0.84		1.18	0	82	10	8	70	10.3	231	-0.74	1.25	0.34	Negative	Negative
11/17/2021	10.6	7.68	3.38	0.77		1.18	0	79	11	10	74	10.2	232	-0.74	1.10	0.40	Negative	Negative
11/18/2021	10.5	7.68	3.37	0.77		1.20	0	79	10	9	78	10.9	227	-0.72	1.11	0.37	Negative	Negative
11/19/2021	10.3	7.67	3.37	0.77		1.21	0	78	10	8	72	10.6	224	-0.77	1.25	0.35	Negative	Negative
11/20/2021	10.2	7.66	3.36	0.77		1.19	0	77	10	8	72	10.8	219	-0.78	1.25	0.36	Negative	Negative
11/21/2021	10.0	7.66	3.36	0.77		1.19	0	77	10	9	72	10.7	223	-0.79	1.11	0.37	Negative	Negative
11/22/2021	9.8	7.69	3.36	0.78		1.22	0	78	10	8	72	10.3	224	-0.76	1.25	0.35	Negative	Negative
11/23/2021	9.7	7.68	3.37	0.77		1.22	0	77	10	8	72	11.4	223	-0.78	1.25	0.36	Negative	Negative
11/24/2021	9.5	7.69	3.37	0.78		1.22	0	74	10	7	72	11.4	216	-0.79	1.43	0.36	Negative	Negative
11/25/2021	9.5	7.68	3.37	0.79		1.21	0	78	12	8	72	10.7	225	-0.78	1.50	0.40	Negative	Negative
11/26/2021	9.3	7.70	3.37	0.79		1.20	0	78	10	8	68	9.6	227	-0.79	1.25	0.35	Negative	Negative
11/27/2021	9.2	7.69	3.37	0.78		1.21	0	78	9	9	68	10.9	227	-0.80	1.00	0.35	Negative	Negative
11/28/2021	9.1	7.69	3.38	0.79		1.22	0	76	10	11	70	10.5	227	-0.80	0.91	0.41	Negative	Negative
11/29/2021	8.7	7.70	3.37	0.78	0.73	1.21	0	76	10	10	68	11.2	228	-0.82	1.00	0.40	Negative	Negative
11/30/2021	8.4	7.70	3.37	0.73		1.19	0	80	10	10	66	11.2	229	-0.81	1.00	0.38	Negative	Negative
						0												
Avg	11.0	7.67	3.38	0.77	0.75	1.20	0	79	10	9	72	10.3	227	-0.75	1.11	0.38	NA	NA
Min	8.4	7.62	3.35	0.73	0.73	1.16	0	74	9	7	66	9.4	216	-0.82	0.83	0.34	NA	NA
Max	13.4	7.70	3.50	0.84	0.76	1.23	0	88	12	12	80	11.4	239	-0.66	1.50	0.43	NA	NA



Turbidity										
Date	Raw Water		Clarified Water	Membrane Feed Water	Combined Membrane Filtrate					Finished Water
	Avg	Max	Avg	Avg	Avg	Max	# Samples	# > 0.3	% Exceeded	Avg
	NTU									
	AIT-1000-1		AIT-5030-1	AIT-1035-3	AIT-4000-1				Calculated	
11/1/2021	5.22	11.90	1.27	5.87	0.022	0.022	96	0	0.0	0.018
11/2/2021	2.58	15.22	1.20	4.09	0.022	0.022	96	0	0.0	0.018
11/3/2021	1.37	1.66	1.51	2.60	0.022	0.022	96	0	0.0	0.018
11/4/2021	1.13	1.87	2.29	1.67	0.022	0.022	96	0	0.0	0.017
11/5/2021	1.01	4.69	2.03	1.14	0.022	0.022	96	0	0.0	0.018
11/6/2021	1.09	1.44	2.11	1.02	0.022	0.022	96	0	0.0	0.017
11/7/2021	1.16	1.68	2.18	1.08	0.022	0.022	96	0	0.0	0.017
11/8/2021	0.98	1.51	2.05	1.07	0.022	0.024	96	0	0.0	0.018
11/9/2021	0.88	1.27	2.01	0.89	0.022	0.022	96	0	0.0	0.018
11/10/2021	0.76	1.68	2.66	0.72	0.022	0.022	96	0	0.0	0.018
11/11/2021	0.76	1.57	2.66	0.68	0.022	0.022	96	0	0.0	0.018
11/12/2021	0.80	1.30	2.72	0.77	0.022	0.022	96	0	0.0	0.018
11/13/2021	1.58	2.83	2.75	1.05	0.022	0.022	96	0	0.0	0.018
11/14/2021	1.67	6.43	2.15	1.22	0.022	0.022	96	0	0.0	0.018
11/15/2021	1.08	4.64	2.32	1.19	0.021	0.022	96	0	0.0	0.018
11/16/2021	0.95	1.35	1.82	1.00	0.021	0.022	96	0	0.0	0.017
11/17/2021	0.80	1.23	2.13	0.92	0.022	0.022	96	0	0.0	0.017
11/18/2021	0.55	0.69	2.27	0.70	0.022	0.022	96	0	0.0	0.017
11/19/2021	0.51	0.71	1.39	0.51	0.022	0.022	96	0	0.0	0.017
11/20/2021	0.75	1.24	1.46	0.50	0.022	0.022	96	0	0.0	0.017
11/21/2021	0.83	1.36	1.85	0.64	0.022	0.022	96	0	0.0	0.017
11/22/2021	0.61	3.85	1.99	0.58	0.022	0.022	96	0	0.0	0.017
11/23/2021	0.56	1.02	2.01	0.50	0.022	0.022	96	0	0.0	0.017
11/24/2021	0.48	1.27	2.18	0.44	0.022	0.022	96	0	0.0	0.017
11/25/2021	0.49	1.09	1.93	0.40	0.022	0.022	96	0	0.0	0.017
11/26/2021	0.51	0.77	2.13	0.39	0.022	0.022	96	0	0.0	0.017
11/27/2021	0.55	0.71	1.83	0.41	0.022	0.022	96	0	0.0	0.017
11/28/2021	0.65	2.39	1.83	0.48	0.022	0.022	96	0	0.0	0.017
11/29/2021	0.62	1.76	2.50	0.47	0.022	0.022	96	0	0.0	0.017
11/30/2021	1.04	8.62	2.38	0.66	0.022	0.022	96	0	0.0	0.017
Avg	1.07	2.93	2.05	1.12	0.022	0.022	96	0	0.0	0.017
Min	0.48	0.69	1.20	0.39	0.021	0.022	96	0	0.0	0.017
Max	5.22	15.22	2.75	5.87	0.022	0.024	96	0	0.0	0.018

Note: % Exceeded are 4 hr compliance periods where the average of samples are greater than 0.3 NTU



Date	Membrane LRV/Integrity/Max Turbidity																									
	Membrane 1			Membrane 2			Membrane 3			Membrane 4			Membrane 5			Membrane 6			Membrane 7			Membrane 8				
	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity	LRV	Integrity	Turbidity		
	Average	Pass/Fail	Max	Average	Pass/Fail	Max	Average	Pass/Fail	Max	Average	Pass/Fail	Max	Average	Pass/Fail	Max	Average	Pass/Fail	Max	Average	Pass/Fail	Max	Average	Pass/Fail	Max		
psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU	psi/min	Pass/Fail	NTU
11/1/2021	4.06	PASS	0.020	4.10	PASS	0.027	4.27	PASS	0.018	4.42	PASS	0.015	4.16	PASS	0.018	4.33	PASS	0.019	4.30	PASS	0.026	4.19	PASS	0.014		
11/2/2021	4.07	PASS	0.019	4.12	PASS	0.027	4.32	PASS	0.018	4.47	PASS	0.015	4.17	PASS	0.018	4.34	PASS	0.019	4.28	PASS	0.026	4.21	PASS	0.013		
11/3/2021	4.06	PASS	0.019	4.10	PASS	0.026	4.22	PASS	0.018	4.50	PASS	0.015	4.16	PASS	0.018	4.33	PASS	0.019	4.31	PASS	0.026	4.20	PASS	0.014		
11/4/2021	4.06	PASS	0.020	4.12	PASS	0.025	4.48	PASS	0.020	4.47	PASS	0.015	4.14	PASS	0.018	4.32	PASS	0.019	4.32	PASS	0.026	4.19	PASS	0.015		
11/5/2021	4.07	PASS	0.019	4.12	PASS	0.025	4.42	PASS	0.018	4.45	PASS	0.015	4.18	PASS	0.018	4.53	PASS	0.018	4.30	PASS	0.026	4.20	PASS	0.012		
11/6/2021	4.07	PASS	0.019	4.11	PASS	0.026	4.38	PASS	0.018	4.75	PASS	0.015	4.21	PASS	0.018	4.52	PASS	0.018	4.31	PASS	0.025	4.22	PASS	0.012		
11/7/2021	4.06	PASS	0.019	4.11	PASS	0.025	4.37	PASS	0.018	4.71	PASS	0.017	4.21	PASS	0.018	4.51	PASS	0.018	4.51	PASS	0.024	4.23	PASS	0.015		
11/8/2021	4.09	PASS	0.019	4.13	PASS	0.026	4.38	PASS	0.018	4.68	PASS	0.015	4.21	PASS	0.019	4.47	PASS	0.018	4.50	PASS	0.025	4.21	PASS	0.014		
11/9/2021	4.10	PASS	0.019	4.12	PASS	0.026	4.39	PASS	0.018	4.67	PASS	0.016	4.20	PASS	0.018	4.44	PASS	0.018	4.49	PASS	0.025	4.21	PASS	0.011		
11/10/2021	4.28	PASS	0.018	4.11	PASS	0.025	4.34	PASS	0.018	4.58	PASS	0.015	4.17	PASS	0.018	4.41	PASS	0.019	4.46	PASS	0.026	4.18	PASS	0.012		
11/11/2021	4.22	PASS	0.018	4.12	PASS	0.025	4.41	PASS	0.018	4.55	PASS	0.016	4.18	PASS	0.018	4.46	PASS	0.019	4.44	PASS	0.025	4.19	PASS	0.012		
11/12/2021	4.20	PASS	0.018	4.13	PASS	0.026	4.36	PASS	0.018	4.54	PASS	0.016	4.20	PASS	0.018	4.41	PASS	0.018	4.40	PASS	0.025	4.19	PASS	0.013		
11/13/2021	4.18	PASS	0.018	4.08	PASS	0.026	4.31	PASS	0.018	4.53	PASS	0.015	4.19	PASS	0.018	4.37	PASS	0.019	4.41	PASS	0.025	4.14	PASS	0.014		
11/14/2021	4.15	PASS	0.018	4.08	PASS	0.024	4.30	PASS	0.018	4.49	PASS	0.016	4.18	PASS	0.018	4.36	PASS	0.019	4.39	PASS	0.025	4.18	PASS	0.012		
11/15/2021	4.13	PASS	0.018	4.09	PASS	0.027	4.36	PASS	0.018	4.48	PASS	0.015	4.16	PASS	0.018	4.36	PASS	0.018	4.33	PASS	0.025	4.19	PASS	0.011		
11/16/2021	4.13	PASS	0.018	4.09	PASS	0.025	4.38	PASS	0.018	4.52	PASS	0.015	4.17	PASS	0.018	4.37	PASS	0.018	4.34	PASS	0.024	4.18	PASS	0.011		
11/17/2021	4.10	PASS	0.018	4.08	PASS	0.025	4.31	PASS	0.018	4.48	PASS	0.015	4.16	PASS	0.018	4.36	PASS	0.018	4.36	PASS	0.025	4.20	PASS	0.011		
11/18/2021	4.11	PASS	0.018	4.11	PASS	0.025	4.28	PASS	0.017	4.45	PASS	0.015	4.17	PASS	0.018	4.40	PASS	0.018	4.35	PASS	0.025	4.19	PASS	0.011		
11/19/2021	4.10	PASS	0.017	4.11	PASS	0.023	4.33	PASS	0.017	4.50	PASS	0.014	4.17	PASS	0.018	4.41	PASS	0.018	4.36	PASS	0.025	4.19	PASS	0.011		
11/20/2021	4.11	PASS	0.018	4.13	PASS	0.025	4.32	PASS	0.017	4.49	PASS	0.015	4.18	PASS	0.018	4.40	PASS	0.018	4.35	PASS	0.025	4.18	PASS	0.011		
11/21/2021	4.13	PASS	0.017	4.12	PASS	0.026	4.31	PASS	0.017	4.50	PASS	0.014	4.18	PASS	0.018	4.38	PASS	0.018	4.34	PASS	0.025	4.18	PASS	0.012		
11/22/2021	4.13	PASS	0.017	4.10	PASS	0.026	4.29	PASS	0.017	4.48	PASS	0.015	4.18	PASS	0.018	4.39	PASS	0.018	4.38	PASS	0.025	4.18	PASS	0.011		
11/23/2021	4.10	PASS	0.017	4.11	PASS	0.026	4.27	PASS	0.017	4.49	PASS	0.015	4.17	PASS	0.018	4.37	PASS	0.018	4.37	PASS	0.025	4.18	PASS	0.012		
11/24/2021	4.09	PASS	0.017	4.12	PASS	0.025	4.27	PASS	0.017	4.49	PASS	0.015	4.18	PASS	0.018	4.35	PASS	0.018	4.36	PASS	0.025	4.18	PASS	0.012		
11/25/2021	4.12	PASS	0.017	4.11	PASS	0.028	4.24	PASS	0.017	4.46	PASS	0.014	4.19	PASS	0.018	4.33	PASS	0.018	4.33	PASS	0.025	4.19	PASS	0.011		
11/26/2021	4.09	PASS	0.017	4.11	PASS	0.028	4.32	PASS	0.017	4.44	PASS	0.015	4.15	PASS	0.018	4.36	PASS	0.018	4.41	PASS	0.025	4.19	PASS	0.012		
11/27/2021	4.10	PASS	0.018	4.13	PASS	0.025	4.30	PASS	0.017	4.47	PASS	0.015	4.16	PASS	0.018	4.41	PASS	0.018	4.32	PASS	0.025	4.19	PASS	0.011		
11/28/2021	4.10	PASS	0.017	4.12	PASS	0.025	4.25	PASS	0.017	4.52	PASS	0.015	4.15	PASS	0.018	4.41	PASS	0.018	4.28	PASS	0.025	4.20	PASS	0.011		
11/29/2021	4.06	PASS	0.017	4.08	PASS	0.025	4.24	PASS	0.017	4.49	PASS	0.015	4.14	PASS	0.018	4.35	PASS	0.018	4.27	PASS	0.025	4.34	PASS	0.012		
11/30/2021	4.03	PASS	0.017	4.10	PASS	0.024	4.21	PASS	0.017	4.42	PASS	0.015	4.13	PASS	0.018	4.31	PASS	0.018	4.24	PASS	0.025	4.37	PASS	0.012		
Avg	4.11		0.018	4.11		0.026	4.32		0.018	4.52		0.015	4.17		0.018	4.39		0.018	4.36		0.025	4.20		0.012		
Min	4.03		0.017	4.08		0.023	4.21		0.017	4.42		0.014	4.13		0.018	4.31		0.018	4.24		0.024	4.14		0.011		
Max	4.28		0.020	4.13		0.028	4.48		0.020	4.75		0.017	4.21		0.019	4.53		0.019	4.51		0.026	4.37		0.015		

\*LRV not to exceed Upper Control Limit of 3.32 psi/min



Treatment Chemical Dosages											
Date	Treated Water	Sodium Hypochlorite					Phosphoric Acid		Hydroflourosilicic Acid		
		Raw Water	Membrane Feed Water	Dose pre-FW Tanks	Treated Water	Post FW Tanks	Dose pre-FW Tanks	Post FW Tanks	Raw Water	Dose pre-FW Tanks	Post FW Tanks
	Volume	Free Cl <sub>2</sub>					PO4		F		
	MG	mg/L					mg/L		mg/L		
	FIT-4000-1	AIT-1035-2	AIT-1035-4	Added	AIT-4030-1	AIT-4050-1	Added	AIT-4040-5	Lab	Added	Lab
11/1/2021	7.2	0.54	0.22	1.25	1.35	1.22	3.42	3.47	0.09	0.63	0.77
11/2/2021	6.8	0.71	0.35	1.23	1.42	1.23	3.24	3.50	0.09	0.63	0.76
11/3/2021	7.3	0.66	0.42	1.08	1.31	1.23	3.26	3.36	0.09	0.63	0.77
11/4/2021	7.2	0.66	0.46	1.08	1.32	1.20	3.27	3.38	0.08	0.63	0.75
11/5/2021	6.9	0.67	0.48	1.12	1.33	1.20	3.27	3.38	0.08	0.63	0.78
11/6/2021	7.1	0.69	0.49	1.04	1.32	1.21	3.27	3.37	0.08	0.63	0.75
11/7/2021	7.7	0.71	0.52	1.00	1.34	1.22	3.27	3.38	0.08	0.63	0.76
11/8/2021	6.4	0.66	0.50	1.00	1.30	1.19	3.27	3.35	0.08	0.63	0.75
11/9/2021	6.9	0.61	0.52	1.07	1.32	1.20	3.30	3.39	0.08	0.64	0.77
11/10/2021	7.3	0.56	0.46	1.06	1.31	1.20	3.30	3.40	0.09	0.64	0.76
11/11/2021	7.0	0.54	0.42	1.15	1.29	1.16	3.29	3.41	0.08	0.64	0.79
11/12/2021	7.0	0.51	0.39	1.15	1.32	1.20	3.29	3.40	0.08	0.64	0.76
11/13/2021	6.8	0.46	0.36	1.22	1.32	1.19	3.28	3.39	0.08	0.64	0.76
11/14/2021	6.7	0.54	0.35	1.21	1.32	1.19	3.28	3.39	0.09	0.64	0.75
11/15/2021	6.8	0.57	0.37	1.18	1.33	1.21	3.28	3.38	0.10	0.64	0.77
11/16/2021	6.5	0.63	0.39	1.25	1.31	1.18	3.28	3.38	0.08	0.64	0.84
11/17/2021	6.8	0.63	0.43	1.15	1.32	1.18	3.28	3.38	0.08	0.64	0.77
11/18/2021	6.4	0.71	0.48	1.18	1.31	1.20	3.28	3.37	0.08	0.64	0.77
11/19/2021	6.7	0.66	0.50	1.10	1.31	1.21	3.28	3.37	0.08	0.64	0.77
11/20/2021	6.9	0.53	0.48	1.18	1.31	1.19	3.28	3.36	0.08	0.64	0.77
11/21/2021	7.1	0.49	0.41	1.20	1.31	1.19	3.28	3.36	0.08	0.64	0.77
11/22/2021	6.9	0.51	0.39	1.20	1.32	1.22	3.28	3.36	0.08	0.64	0.78
11/23/2021	6.8	0.49	0.39	1.20	1.31	1.22	3.28	3.37	0.08	0.64	0.77
11/24/2021	7.0	0.52	0.39	1.19	1.33	1.22	3.28	3.37	0.09	0.64	0.78
11/25/2021	6.9	0.51	0.40	1.20	1.29	1.21	3.28	3.37	0.09	0.64	0.79
11/26/2021	6.7	0.51	0.40	1.26	1.28	1.20	3.28	3.37	0.08	0.64	0.79
11/27/2021	6.9	0.52	0.39	1.15	1.31	1.21	3.28	3.37	0.09	0.63	0.78
11/28/2021	6.6	0.63	0.44	1.12	1.30	1.22	3.28	3.38	0.09	0.63	0.79
11/29/2021	6.8	0.58	0.47	1.15	1.29	1.21	3.28	3.37	0.08	0.63	0.78
11/30/2021	6.9	0.51	0.43	1.17	1.27	1.19	3.29	3.37	0.07	0.63	0.73
Avg	6.9	0.58	0.42	1.15	1.32	1.20	3.28	3.38	0.08	0.64	0.77
Min	6.4	0.46	0.22	1.00	1.27	1.16	3.24	3.35	0.07	0.63	0.73
Max	7.7	0.71	0.52	1.26	1.42	1.23	3.42	3.50	0.10	0.64	0.84





Disinfection CT														
Date	Pipeline CT				FW Tank CT						Compliance			
	Whitestone	Travel Time	Residual	CT	FW Tank 1	FW Tank 2	Plant	Contact Time	Free Cl <sub>2</sub>	CT	Total CT	Temp	CT	CT
	Flow	Min	RW	Achieved	Min Level	Min Level	Flow	Min	Min	Achieved	Achieved	Avg	Required	Met
	MGD	Minutes	mg/L	mg-min/L	ft	ft	MGD	Minutes	mg/L	mg-min/L	mg-min/L	°C	mg-min/L	Y/N
	Entry	Calculated	AIT-1035-2	Calculated	LIT-4005-1	LIT-4005-2	Calculated	Calculated	Calculated	Calculated	Calculated	TIT-1000	Calculated	Calculated
11/1/2021	49.9	2,507	0.54	1358	28.7	24.1	6.7	542	1.11	600	1958	14.5	6.00	Y
11/2/2021	47.8	2,616	0.71	1846	28.7	24.0	6.7	536	1.16	623	2468	14.2	6.00	Y
11/3/2021	35.3	3,549	0.66	2354	28.7	24.0	7.0	516	1.16	599	2953	14.3	6.00	Y
11/4/2021	38.4	3,259	0.66	2160	28.7	23.9	7.0	518	1.18	612	2772	14.2	6.00	Y
11/5/2021	43.6	2,870	0.67	1937	28.7	24.5	6.6	550	1.15	635	2572	14.1	6.00	Y
11/6/2021	53.5	2,340	0.69	1625	28.7	24.4	6.8	536	1.12	601	2225	13.9	6.00	Y
11/7/2021	53.8	2,324	0.71	1657	28.7	24.6	7.3	497	1.16	577	2234	13.6	6.00	Y
11/8/2021	42.9	2,915	0.66	1936	28.2	17.5	6.3	495	1.15	568	2505	13.5	6.00	Y
11/9/2021	42.6	2,939	0.61	1798	28.7	23.5	6.6	544	1.18	639	2437	13.1	6.00	Y
11/10/2021	44.2	2,829	0.56	1587	28.8	23.3	6.9	518	1.17	605	2192	13.1	6.00	Y
11/11/2021	40.4	3,097	0.54	1664	28.7	23.7	6.8	530	1.05	557	2222	12.9	6.00	Y
11/12/2021	40.4	3,095	0.51	1580	28.8	23.8	6.7	540	1.18	638	2218	12.6	6.00	Y
11/13/2021	48.1	2,602	0.46	1189	28.7	23.9	6.4	559	1.12	625	1815	12.3	6.00	Y
11/14/2021	48.9	2,557	0.54	1369	28.7	22.9	6.5	547	1.15	628	1996	12.2	6.00	Y
11/15/2021	43.5	2,877	0.57	1635	28.7	23.4	6.4	561	1.11	621	2255	11.9	6.00	Y
11/16/2021	38.9	3,217	0.63	2029	28.7	24.7	6.2	590	1.16	686	2714	11.7	6.00	Y
11/17/2021	39.7	3,154	0.63	1994	28.7	24.7	6.5	562	1.15	649	2644	11.6	6.00	Y
11/18/2021	37.3	3,358	0.71	2373	28.7	23.9	6.2	584	1.18	690	3063	11.5	6.00	Y
11/19/2021	40.2	3,111	0.66	2042	28.7	24.5	6.4	568	1.17	663	2705	11.5	6.00	Y
11/20/2021	54.8	2,281	0.53	1204	28.7	24.1	6.5	555	1.15	636	1840	11.3	6.00	Y
11/21/2021	49.3	2,538	0.49	1231	28.7	24.9	6.8	540	1.18	639	1870	11.2	6.00	Y
11/22/2021	44.5	2,812	0.51	1438	28.7	23.7	6.6	542	1.20	648	2086	11.1	6.00	Y
11/23/2021	40.4	3,095	0.49	1522	28.7	23.7	6.4	560	1.20	674	2195	11.0	6.00	Y
11/24/2021	37.4	3,345	0.52	1751	28.7	24.2	6.8	532	1.20	639	2390	10.9	6.00	Y
11/25/2021	36.0	3,473	0.51	1767	28.7	22.9	6.6	540	1.17	634	2401	10.8	6.00	Y
11/26/2021	40.1	3,117	0.51	1594	28.7	23.8	6.4	560	1.17	658	2252	10.8	6.00	Y
11/27/2021	50.8	2,463	0.52	1283	28.7	23.8	6.5	550	1.17	646	1929	10.6	6.00	Y
11/28/2021	51.0	2,454	0.63	1558	28.7	24.5	6.3	578	1.19	687	2245	10.5	6.00	Y
11/29/2021	42.0	2,975	0.58	1733	28.7	24.0	6.6	550	1.18	650	2383	9.4	8.00	Y
11/30/2021	38.3	3,269	0.51	1661	28.7	23.9	6.6	546	1.17	638	2299	8.7	8.00	Y
Avg	43.8	2,901	0.58	1696	28.7	23.8	6.6	545	1.16	632	2328	12.1	6.13	NA
Min	35.3	2,281	0.46	1189	28.2	17.5	6.2	495	1.05	557	1815	8.7	6.00	NA
Max	54.8	3,549	0.71	2373	28.8	24.9	7.3	590	1.20	690	3063	14.5	8.00	NA



**Notes:**

Pipeline volume factor in SMMWSC to RW tank: 125,090 MG-min/day

Distribution System Monitoring																								
Chlorine Residual at Bacteriological Monitoring Stations (mg/L Free Cl2)																								
WSSN:	0072	0390				0400			0470							0485					0517	0518		2180
Date	Akron	Bangor Twp.				Bangor Monitor Dist.			Bay City							Bay County					Beaver Rd	Beaver Twp		Essexville
	1	3	4	5	6	7	9	10	11	12	13	14	15	16	17	18	19	20	23	24	26	29	30	32
11/1/2021																								1.04
11/2/2021									0.81	0.34	0.51	0.87	0.28	1.03	0.72									
11/3/2021																								
11/4/2021	0.27	0.70	0.65	0.41	1.19				0.81	0.33	0.47	0.77	0.28	1.10	0.73	1.01	1.03	1.01	0.65	0.76		0.35		
11/5/2021																								
11/6/2021																								
11/7/2021																								
11/8/2021																								1.04
11/9/2021						0.87	1.12																	
11/10/2021									0.89	0.40	0.50	0.86	0.29	1.16	0.72									
11/11/2021								1.17													1.06			
11/12/2021																								
11/13/2021																								
11/14/2021																								
11/15/2021																								
11/16/2021									0.68	0.42	0.74	0.82	0.26	1.04	0.73									
11/17/2021																								
11/18/2021				0.52	1.09				0.53	0.12	0.61	0.83	0.28	1.01	0.67	1.02	0.96	1.01	0.72			0.52		
11/19/2021																								1.04
11/20/2021																								
11/21/2021																								
11/22/2021																								
11/23/2021		0.86	0.77	0.74	1.04				0.82	0.45	0.74	0.80	0.36	0.97	0.80									1.02
11/24/2021																								
11/25/2021																								
11/26/2021																								
11/27/2021																								
11/28/2021																								
11/29/2021																								
11/30/2021									0.84	0.69	0.70	0.67	0.48	1.09	0.84					0.66				1.01
Average	0.27	0.80				1.05			0.67							0.88					1.06	0.44		1.03
Min	0.27	0.41				0.87			0.12							0.65					1.06	0.35		1.01
Max	0.27	1.19				1.17			1.16							1.03					1.06	0.52		1.04



MONITORING STATION ADDRESSES

- |  |   |   |
|--|---|---|
| 1. Sample station at corner of 5758 M-25 & F | 11. Number 1 Fire Station, 1401 Center Ave        | 19. Dore's M-84 Party Store, 6183 WS Saginaw Rd |
| 3. Bangor Fire Station, 3921 Wheeler         | 12. Number 2 Fire Station, 1000 Fremont Ave       | 20. Pump Station #13, 6000 WS Saginaw Rd        |
| 4. BCDWS Admin. Bldg. 3933 Patterson Rd.     | 13. Skizak's Sport Shop, 807 Salzburg Ave         | 23. Rail Trail Pump Station, 366 N. Tuscola Rd. |
| 5. 7-11, 3543 S. Old Kawkawlin Rd.           | 14. Number 4 Fire Station, 212 S. Dean St         | 24. Little Learners Daycare, 1694 Cass Ave.     |
| 6. Admiral Petroleum, 314 S Euclid Ave.      | 15. Number 5 Fire Station, 1209 Smith St          | 26. Wieland Contracting, 2443 S Mackinaw Rd     |
| 7. Sequin Lumber, 3881 Euclid Ave            | 16. Bay City Hall, 301 Washington Ave             | 29. Sample Station, 2515 S. 11 Mile Rd          |
| 9. B's Boutique, 2981 Midland Rd             | 17. Skipper Buds Marina, 1809 S Water St          | 30. Sample Station, 340 W. Beaver Rd            |
| 10. Little Caesars, 3475 E North Union Rd    | 18. Bay Valley Animal Hospital 6015 WS Saginaw Rd | 32. Essexville City Hall, 1107 Woodside Ave     |

Distribution System Monitoring																								
Chlorine Residual at Bacteriological Monitoring Stations (mg/L Free Cl2)																								
WSSN:	2465		2960			3565			3570		4280		4440			5330		5335		5540	7125			7134
	Fraser Twp.		Hampton Twp.			Kawkawlin Twp.			Kawkawlin Met.		Merritt Twp.		Monitor Twp.			City Pinconning		Pinconning Twp.		Portsmouth	Williams Twp.			Wisner
Date	34	35	37	38	39	40	41	42	43	45	46	48	49	52	55	58	59	61	63	65	68	69	70	72
11/1/2021																								
11/2/2021			0.62	0.74	0.51																			
11/3/2021																								
11/4/2021											0.42									0.62	0.69	0.70		0.61
11/5/2021																								
11/6/2021																								
11/7/2021																								
11/8/2021																								
11/9/2021	0.60	1.03				1.10	1.08		0.96				1.04	0.70	0.83	0.80		1.01	0.90					
11/10/2021																								
11/11/2021								0.86	0.78				1.03	0.75	0.84									
11/12/2021			0.50	0.37	0.48																			
11/13/2021																								
11/14/2021																								
11/15/2021																								
11/16/2021			0.61	0.33	0.55																			
11/17/2021																								
11/18/2021											0.36										0.85	0.61	0.71	
11/19/2021																								
11/20/2021																								
11/21/2021																								
11/22/2021			0.43	0.31	0.58																			
11/23/2021																0.81								
11/24/2021																								
11/25/2021																								
11/26/2021																								
11/27/2021																								
11/28/2021																								
11/29/2021																								
11/30/2021																						0.74	0.58	
Average	0.82		0.50			1.01			0.87		0.39		0.87			0.81		0.96		0.62		0.70		0.61
Min	0.60		0.31			0.86			0.78		0.36		0.70			0.80		0.90		0.62		0.58		0.61
Max	1.03		0.74			1.10			0.96		0.42		1.04			0.81		1.01		0.62		0.85		0.61



MONITORING STATION ADDRESSES

- 34. Fraser Elevated Tank, 2949 1/2 N. Huron Rd
- 35. Lloyd's Cabinet, 1947 N Huron Rd
- 37. Hampton DPW, 950 Wagner Rd.
- 38. Bay County Golf Course, 584 W Hampton Rd.
- 39. Sewer Lift Station, 902 Nebobish Rd.
- 40. Bay Co. Road Commisison, 2600 E Beaver Rd
- 41. Parish Rd. Elevated Tank, 1770 E. Parish Rd
- 42. Linwood Tile, 205 S Huron Rd

- 43. Kawkawlin Party Store, 105 Grove St
- 45. Kawkawlin Restaurant, 103 S Huron Rd
- 46. John's Bar, 1476 S Tuscola Rd
- 48. Tool Shed Bar, 12 W Munger Rd
- 49. Wilder Rd Party Store, 2951 E Wilder Rd
- 52. Monitor Twp. Elevated Tank, 1611 E. Midland Rd
- 55. Auburn Fertilizer, 4640 S 7 Mile Rd
- 58. Pinconning City Hall, 208 S Manitou St

- 59. Marathon Gas Station, 511 S Mabel St
- 61. Pinconning Meter Pit, 3005 N Huron Rd
- 63. Master Meter Pit, 2865 Pinconning Rd
- 65. Ike's Welding, 50 N Finn Rd
- 68. Williams Township Hall, 1080 W Midland Rd
- 69. Pump Station, 490 W. Salzburg & 9 Mile Rd
- 70. 11 Mile Elevated Tank, 5003 S. 11 Mile Rd
- 72. Lindy's Sales, 9051 M-25

**Distribution System Bacteriological**

Water Supplier Bacteriological Analysis Report

MICHIGAN DEPARTMENT OF PUBLIC HEALTH  
 Bureau of Environmental Health  
 Water Supplier Bacteriological Analysis Report

Name of Water Supply  
**Bay Area Water Treatment Plant**

November, 2021

COUNTY	COMMUNITY	WSSN NUMBER	DISTRIBUTION SYSTEM SAMPLES				
			avg free cl2 mg/L	NUMBER REQUIRED	NUMBER COLLECTED	NUMBER POSITIVE	NUMBER REPEAT SAMPLES
Tuscola	Akron	0072	0.27	1	1	0	0
BAY	Bangor Township	0390	0.80	10	10	0	0
BAY	Bangor-Monitor Dist.	0400	1.05	3	3	0	0
BAY	Bay City	0470	0.67	30	49	0	0
BAY	Bay County (Frankl./Monitor/Portsm.)	0485	0.88	9	10	0	0
BAY	Beaver Road Area	0517	1.06	1	1	0	0
BAY	Beaver Township	0518	0.44	2	2	0	0
BAY	Essexville	2180	1.03	4	5	0	0
BAY	Fraser Township	2465	0.82	2	2	0	0
BAY	Hampton Township	2960	0.50	10	12	0	0
BAY	Kawkawlin Township	3565	1.01	3	3	0	0
BAY	Kawkawlin Metro Dist.	3570	0.87	2	2	0	0
BAY	Merritt Township	4280	0.39	2	2	0	0
BAY	Monitor Township	4440	0.87	6	6	0	0
BAY	City of Pinconning	5330	0.81	2	2	0	0
BAY	Pinconning Township	5335	0.96	2	2	0	0
BAY	Portsmouth Township	5540	0.62	1	1	0	0
BAY	Williams Township	7125	0.70	6	7	0	0
Tuscola	Wisner	7134	0.61	1	1	0	0

Average Free Cl2 Residual of All Distribution Sites 0.75 mg/L

- |  |       |
|--|-------|
| 1. Total distribution samples  | 121   |
| 2. Total distribution samples with detectable free cl2 residual                        | 121   |
| 3. Total distribution samples with no detectable free cl2 residual                     | 0     |
| 4. Total distribution samples with no detectable free cl2 residual<br>and HPC was <500 | 0     |
| 5. Total distribution samples with no detectable free cl2 residual<br>and HPC was >500 | 0     |
| 6. Percent of distribution samples with no detectable free cl2 residual                | 0.00% |
| 7. Percent shown line #6 in previous monthly report                                    | 0.00% |

